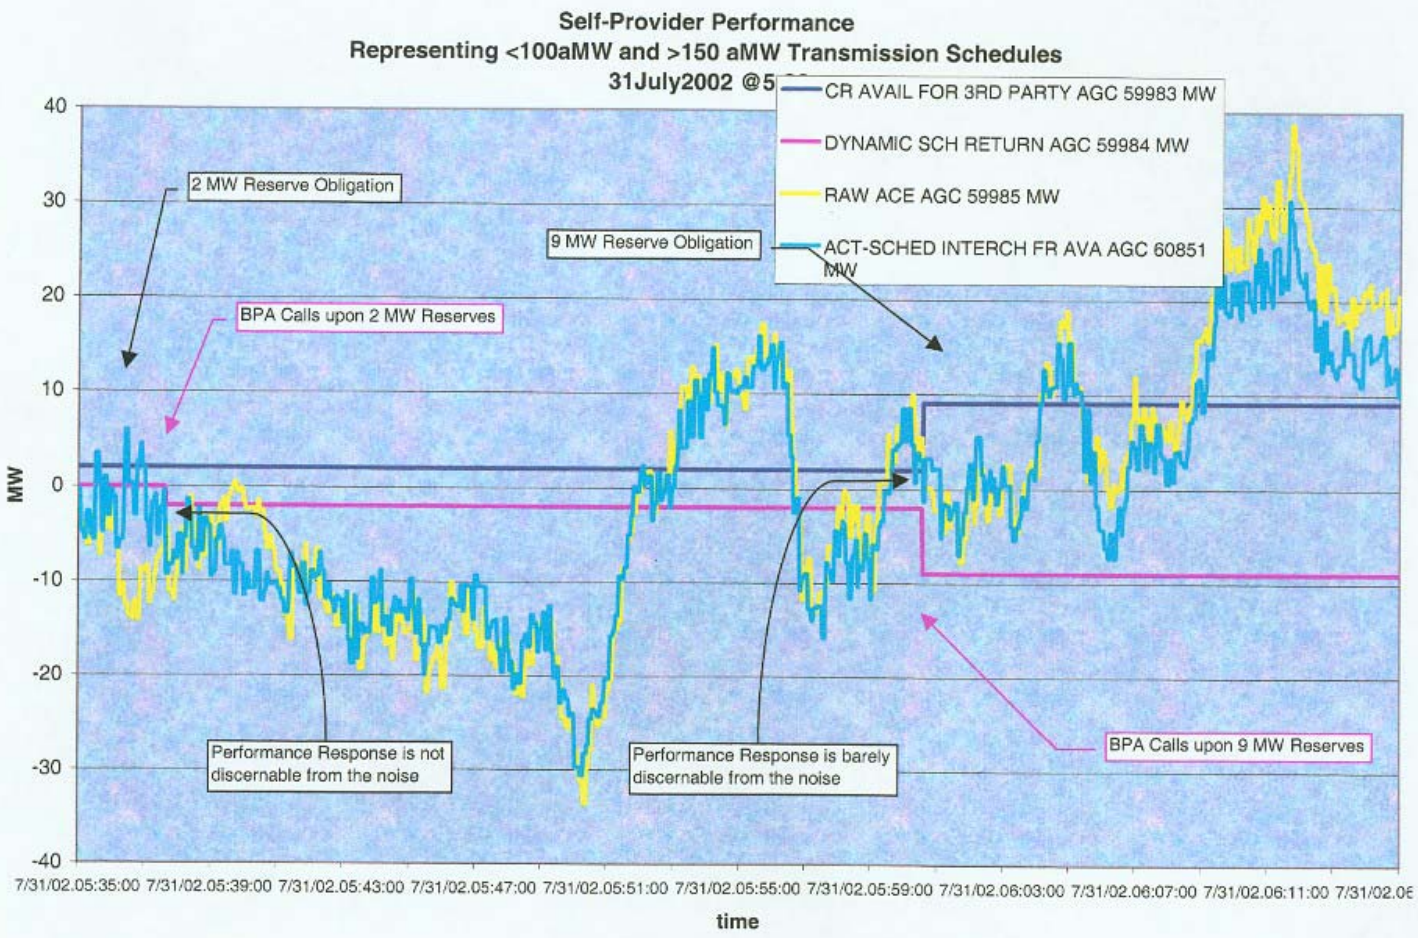
Self-Provider Performance
Representing <100aMW and >150 aMW Transmission Schedules
31July2002 @5
CR AVAIL FOR 3RD PARTY AGC 59983 MW
DYNAMIC SCH RETURN AGC 59984 MW
RAW ACE AGC 59985 MW
ACT-SCHED INTERCH FR AVA AGC 60851 MW
2 MW Reserve Obligation
9 MW Reserve Obligation
BPA Calls upon 2 MW Reserves
BPA Calls upon 9 MW Reserves
Performance Response is not discernable from the noise
Performance Response is barely discernable from the noise
MW
40
30
20
10
0
-10
-20
-30
-40
7/31/02.05:35:00
7/31/02.05:39:00
7/31/02.05:43:00
7/31/02.05:47:00
7/31/02.05:51:00
7/31/02.05:55:00
7/31/02.05:59:00
7/31/02.06:03:00
7/31/02.06:07:00
7/31/02.06:11:00
time

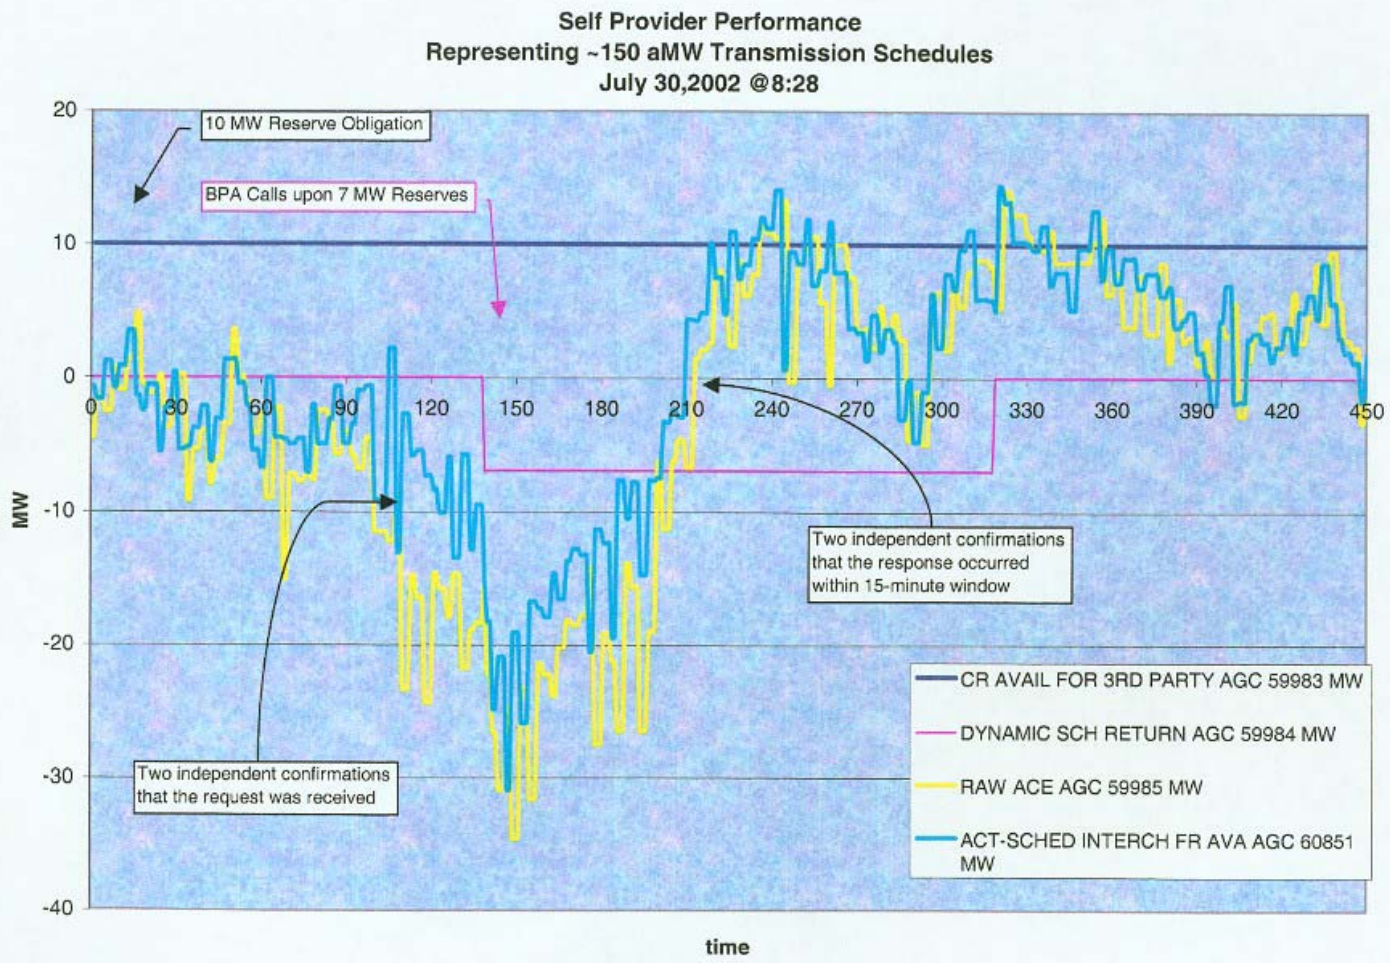
Self Provider Performance
Representing ~150 aMW Transmission Schedules
July 30,2002 @8:28
10 MW Reserve Obligation
BPA Calls upon 7 MW Reserves
Two independent confirmations that the response occurred within 15-minute window
Two independent confirmations that the request was received
CR AVAIL FOR 3RD PARTY AGC 59983 MW
DYNAMIC SCH RETURN AGC 59984 MW
RAW ACE AGC 59985 MW
ACT-SCHED INTERCH FR AVA AGC 60851 MW
MW
time
20
10
0
-10
-20
-30
-40
0
30
60
90
120
150
180
210
240
270
300
330
360
390
420
450